


Iron distribution in groundwater of the Slovak Republic - municipalities

Fe
Iron
groundwater

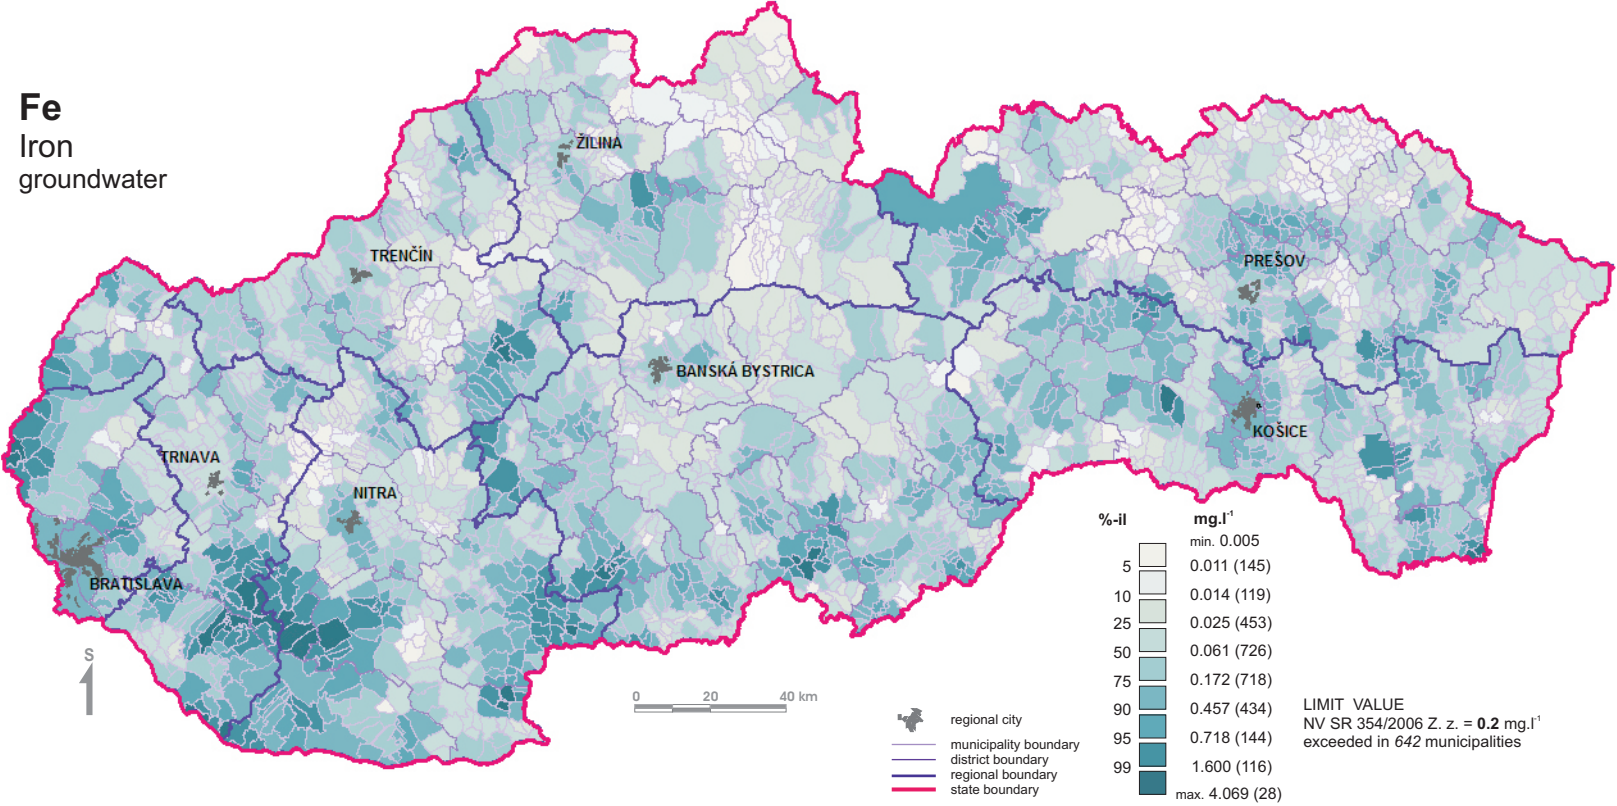

%-il	mg.l ⁻¹
	min. 0.005
5	0.011 (145)
10	0.014 (119)
25	0.025 (453)
50	0.061 (726)
75	0.172 (718)
90	0.457 (434)
95	0.718 (144)
99	1.600 (116)
	max. 4.069 (28)

LIMIT VALUE
NV SR 354/2006 Z. z. = 0.2 mg.l⁻¹
exceeded in 642 municipalities

Note: No. in brackets represents number of municipalities in correspondent intervals.