


# Fluorides distribution in groundwater of the Slovak Republic - districts

**F**  
Fluorides  
groundwater

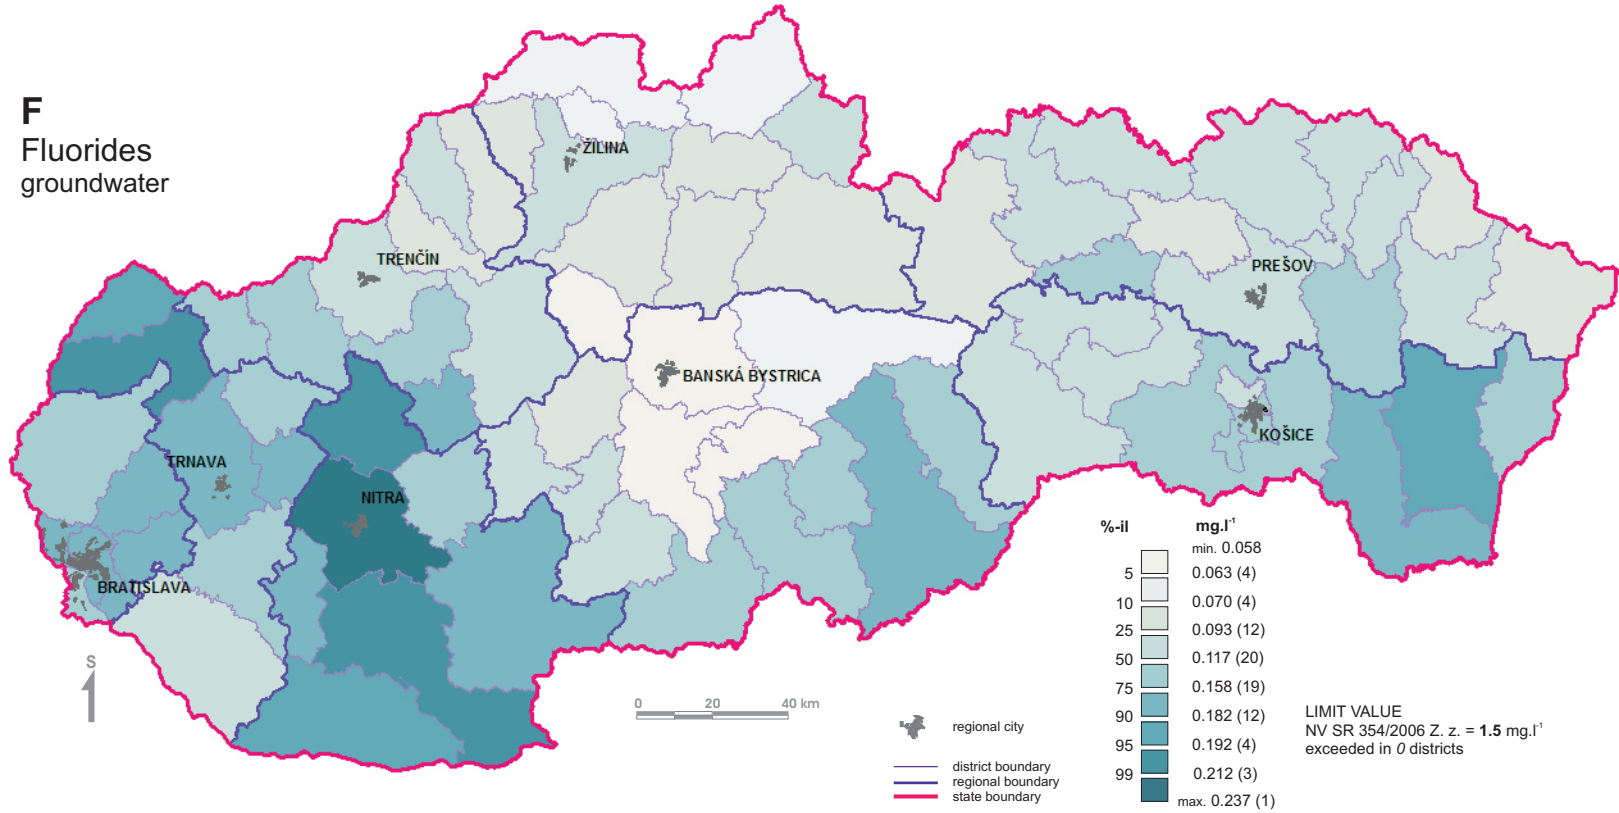

%-il	mg.l <sup>-1</sup>
	min. 0.058
5	0.063 (4)
10	0.070 (4)
25	0.093 (12)
50	0.117 (20)
75	0.158 (19)
90	0.182 (12)
95	0.192 (4)
99	0.212 (3)
	max. 0.237 (1)

LIMIT VALUE  
NV SR 354/2006 Z. z. = 1.5 mg.l<sup>-1</sup>  
exceeded in 0 districts

Note: No. in brackets represents number of districts in correspondent intervals.