


Cadmium distribution in groundwater of the Slovak Republic - municipalities

Cd
Cadmium
groundwater

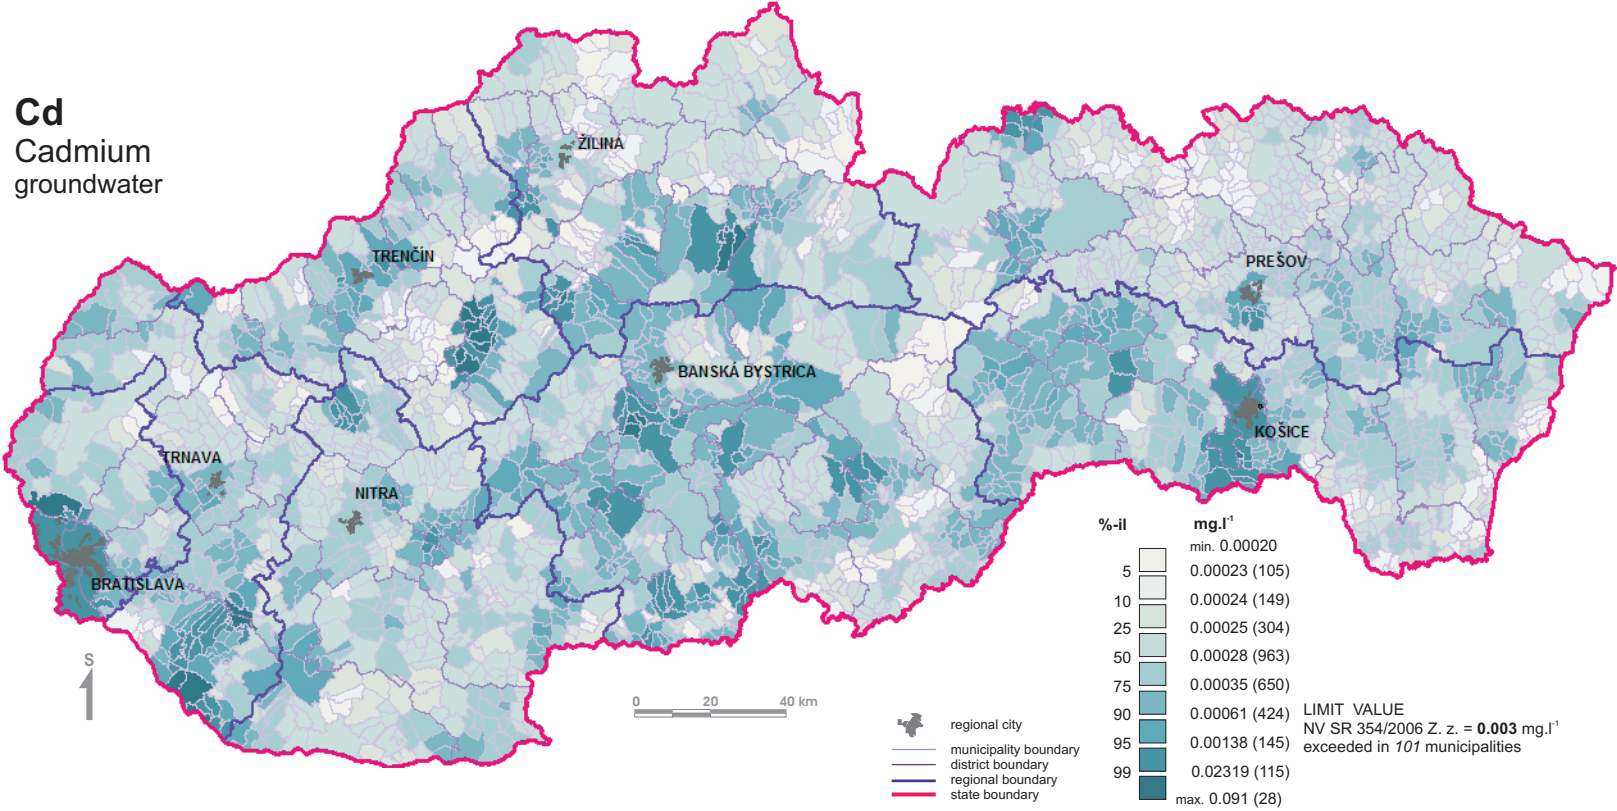

%-il	mg.l ⁻¹
	min. 0.00020
5	0.00023 (105)
10	0.00024 (149)
25	0.00025 (304)
50	0.00028 (963)
75	0.00035 (650)
90	0.00061 (424) LIMIT VALUE
95	0.00138 (145) NV SR 354/2006 Z. z. = 0.003 mg.l ⁻¹
99	0.02319 (115) exceeded in 101 municipalities
	max. 0.091 (28)

Note: No. in brackets represents number of municipalities in correspondent intervals.